


TOP VIEW

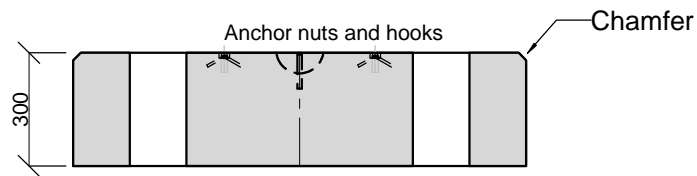

SECTION

SPECIFICATION:

1. Concrete $f_{cu} = 30\text{MPa}$
2. Reinforcing steel to SANS 920
Detailing to bending schedule.
3. All steel except reinforcing is stainless steel.

References:
Eskom Drawing No. D-DT-0861 Sheet 2
SAP No. 0185545
NRS 095:2012 Figure A.9
Vanstone: P8-NRS-A.9

PLINTH FOR CT-VT UNITS
1200 x 750 x 300

Vanstone Precast (Pty) Ltd
www.vanstone.co.za
Tel 012 541 2056

