



CABLE ENTRY COVER

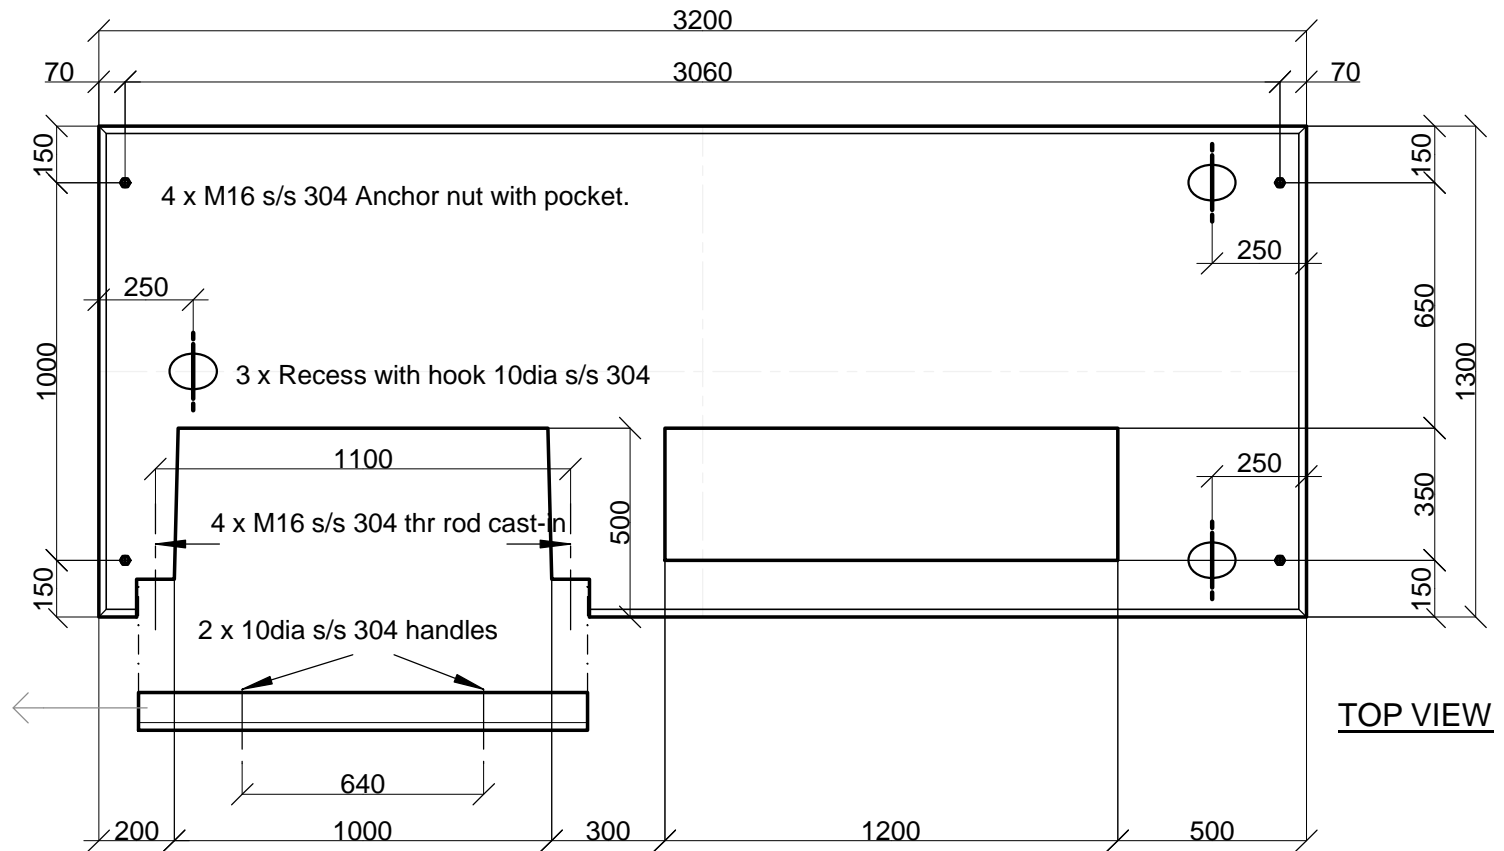

TOP VIEW

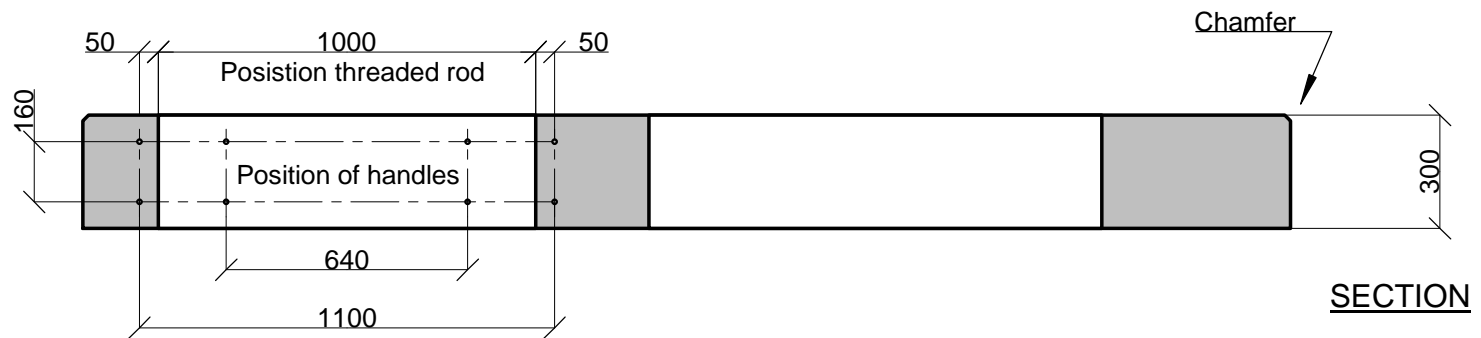

SECTION

SPECIFICATION:

1. Concrete fcu = 30MPa
2. Reinforcing steel to SANS 920
Detailing to bending schedule.
3. All steel except reinforcing is stainless steel.

**PLINTH FOR MINI SUB-STATION
TYPE B
3200 x 1300 x 300**

References:
Eskom Drawing No. D-DT-0859 Sheet 7
SAP No. 0185544
NRS 095:2012 Figure A.2

Vanstone Precast (Pty) Ltd
www.vanstone.co.za
Tel 012 541 2056

